

BSLBATT[®]

Best Solution Lithium Battery

USER MANUAL

10.2KWH POWER WALL LITHIUM-ION BATTERY



SAFETY GUIDELINES



Work or maintenance on the BSL battery should be carried out by qualified personnel only.

Do not attempt to open or dismantle battery and/or cells.



The electrolyte contained in the battery cells is highly corrosive. In the event of any damage to or leakage from the cells, treat contents with care, do not allow contact with exposed skin or eyes. **DO NOT INGEST.**



The terminals of the BSL battery should always be considered live, therefore do not place tools or any other items across the terminals. Do not pierce, short or damage the terminals in any way. Do not touch the terminals of the battery.



Fire Hazard: Do not discharge battery below specified minimum level as this poses an increased fire risk. Do not attempt to charge a swollen or damaged battery. In the event of fire, a CO_2 or Dry Powder extinguisher should be used. Class D extinguishers are not suitable.



Dispose of batteries through the proper local regulations. Not suitable for regular refuse/recycling.

Contents

1	Pin out diagram	1
2	Battery set-up	3
2.1	General	3
2.1.1	Turning battery on and off	3
2.1.2	CAN communication	3
2.1.3	Smart shunt	3
2.1.4	Dry contacts	3
2.1.5	Other ports	3
2.2	Multiple batteries	4
2.2.1	Max number of parallel batteries	4
2.2.2	Installing multiple batteries	4
2.2.3	Cable sizing with multiple batteries	4
2.2.4	Dip switch settings for multiple batteries	4
3	Inverter set-up	5
3.1	Batteries per inverter size	5
3.2	Battery set-up on Victron GX device	5
3.3	MMPT setup	6
4	Inverter settings (Victron)	7
4.1	General Tab	7
4.2	Grid Tab	7
4.3	Inverter Tab	8
4.4	Charger Tab	8
4.5	Virtual switch Tab	9
4.6	Assistant tab (a)	9
4.7	Assistant tab (b)	10
4.8	Assistant tab (c)	10
4.9	Assistant tab (d)	11
4.10	Assistant tab (e)	11
4.11	Assistant tab (f)	12
4.12	Assistant tab (g)	12
5	Revision history	13

List of Figures

1	Pin-out diagram for 10.2kWh BSL battery.	1
2	Pin-out diagram for 10.2kWh BSL battery.	2
3	MPPT setup example	6

1 Pin out diagram

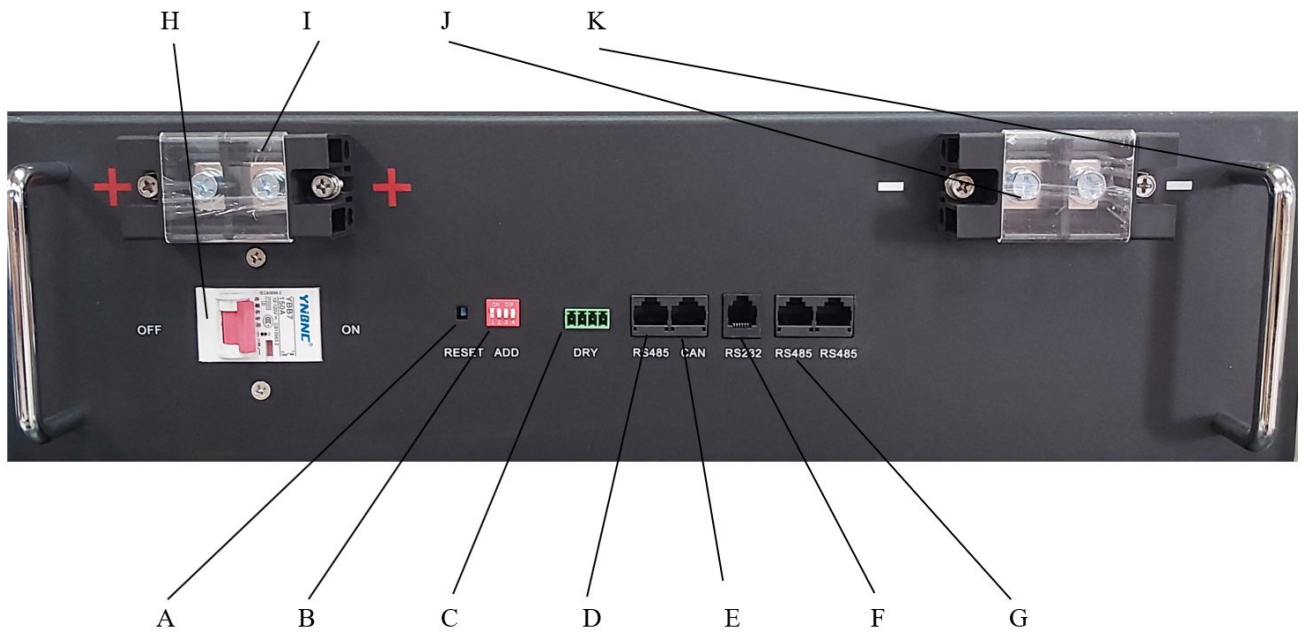


Figure 1: Pin-out diagram for 10.2kWh BSL battery.

- A - Reset switch (BMS Power button)
- B - Dip switches for parallel connection
- C - Dry Contacts (mostly unused)
- D - RS485 Left port (Port 1)
- E - CAN Port (Port 2)
- F - RS232 Port (Unused)
- G - RS485 Right Ports (Ports 4 & 5)
- H - Circuit breaker (terminal power)
- I - Positive terminal
- J - Negative terminal
- K - Carry handles

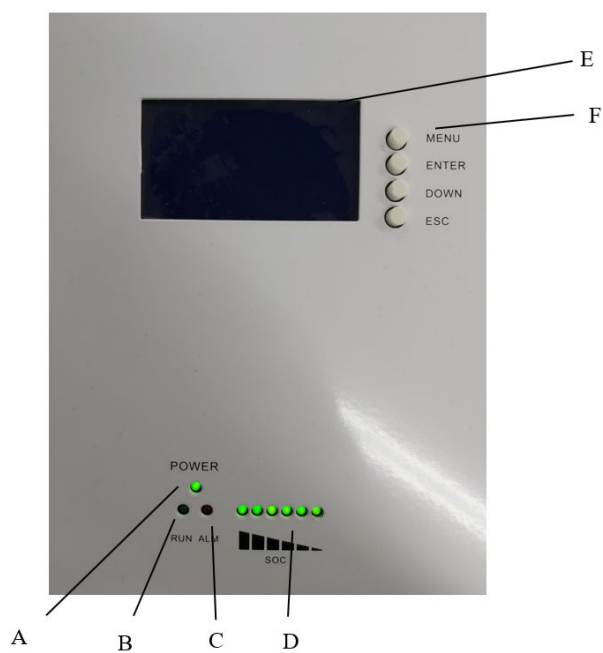


Figure 2: Pin-out diagram for 10.2kWh BSL battery.

- A - Power light
- B - Run light
- C - Alarm light
- D - SOC indicator lights
- E - Screen for display
- F - Push buttons to change settings

2 Battery set-up

2.1 General

2.1.1 Turning battery on and off

The battery can be switched on or off by holding down the small recessed button marked “RESET”.

2.1.2 CAN communication

A VE.Can to CAN-bus BMS “Type B” cable is required for CAN-Bus communication between the BSL battery and the Victron GX device. Some inverters will use different cable configuration, please check this with inverter suppliers. (Black to inverter/GX device, red to battery).

Function	Victron <u>VE.Can</u> Side (GX)	Battery side
GND	Pin 3	Pin 2
CAN - L	Pin 8	Pin 5
CAN - H	Pin 7	Pin 4


2.1.3 Smart shunt

A Battery Monitoring Device (Victron BMV/Smartshunt) is not required as State of Charge (SOC) is sent to the GX device via the CAN-Bus cable.

2.1.4 Dry contacts

Dry Contacts are mostly unused, but for communication with some non-smart systems please see the table below. Working current should be less than 2A, mainly to connect with an external indicator light or buzzer.

PIN1 to PIN2	Always open, will close with low battery signal
PIN3 to PIN4	Always Open, will close with fault/protection signal.



2.1.5 Other ports

Port 1 (RS485) and port 3 (RS232) are used for programming and retrieving information only and must be left open.

2.2 Multiple batteries

2.2.1 Max number of parallel batteries

A maximum of 15 batteries can be connected in parallel. Each battery will require a unique binary address which can be setup via the dip-switches located on the front of the battery.

2.2.2 Installing multiple batteries

When installing more than one battery in parallel, a standard RJ45 patch network cable will be required for inter-battery communication. These cables will need to be connected to port 4 or 5 between all the connected batteries. The ports are paralleled therefore any port can be used for in or out connection.

2.2.3 Cable sizing with multiple batteries

It is recommended to make use of a common rail bus-bar when more than 4 batteries are to be installed. All positive cables running between the battery and bus-bar must be the same length and all negative cables must be the same length. The batteries should be evenly grouped where possible.

The recommended battery cable sizes from the batteries (going to the inverter) in parallel are as follows: 1 battery - $35mm^2$, 2 batteries - $50mm^2$, 3 batteries - $70mm^2$ or $2 \times 35mm^2$, 4 batteries - $95mm^2$ or $2 \times 50mm^2$

2.2.4 Dip switch settings for multiple batteries

Address	DIP switch position				Note
	#1	#2	#3	#4	
0	ON	OFF	OFF	OFF	stand-alone use
1	ON	OFF	OFF	OFF	master Pack
2	OFF	ON	OFF	OFF	Auxiliary Pack1
3	ON	ON	OFF	OFF	Auxiliary Pack2
4	OFF	OFF	ON	OFF	Auxiliary Pack3
5	ON	OFF	ON	OFF	Auxiliary Pack4
6	OFF	ON	ON	OFF	Auxiliary Pack5
7	ON	ON	ON	OFF	Auxiliary Pack6
8	OFF	OFF	OFF	ON	Auxiliary Pack7
9	ON	OFF	OFF	ON	Auxiliary Pack8
10	OFF	ON	OFF	ON	Auxiliary Pack9
11	ON	ON	OFF	ON	Auxiliary Pack10
12	OFF	OFF	ON	ON	Auxiliary Pack11
13	ON	OFF	ON	ON	Auxiliary Pack12
14	OFF	ON	ON	ON	Auxiliary Pack13
15	ON	ON	ON	ON	Auxiliary Pack14

3 Inverter set-up

3.1 Batteries per inverter size

Inverter size	Recommended N.O. batteries	Minimum N.O. of batteries
15kVA	4	3
10kVA	3	2
8kVA	2	2
5kVA	1	1
3kVA	1	1

3.2 Battery set-up on Victron GX device

1. The VE.Can to CAN-bus BMS Type B cable needs to be connected to the VE.Can port on the GX device and the second unused VE.Can port needs to be terminated with the Victron blue terminator. Ensure that the cable is marked CCGX at the end.
2. Press the enter button on the GX device. This should take you to the device list page. Scroll down to settings, press enter, and scroll to services and press enter again. Navigate to the CAN settings and change the CAN speed from 250 KB to 500 KB.
3. Scroll to DVCC and select Switch DVCC on. Flag SHARED VOLTAGE SENSE and CHARGE LIMIT. Set CCL (charge current limit) to **80 amps/battery**.
4. Navigate back to the device list and the BSL battery should appear on the device list.
5. Select the BSL battery set the parameters as follows:
 - Charge Voltage 54.5V.
 - Charge Current Limit: 100A per battery (recommended 80A).
 - Discharge Current Limit: 150A per battery (constant 125A).



3.3 MMPT setup


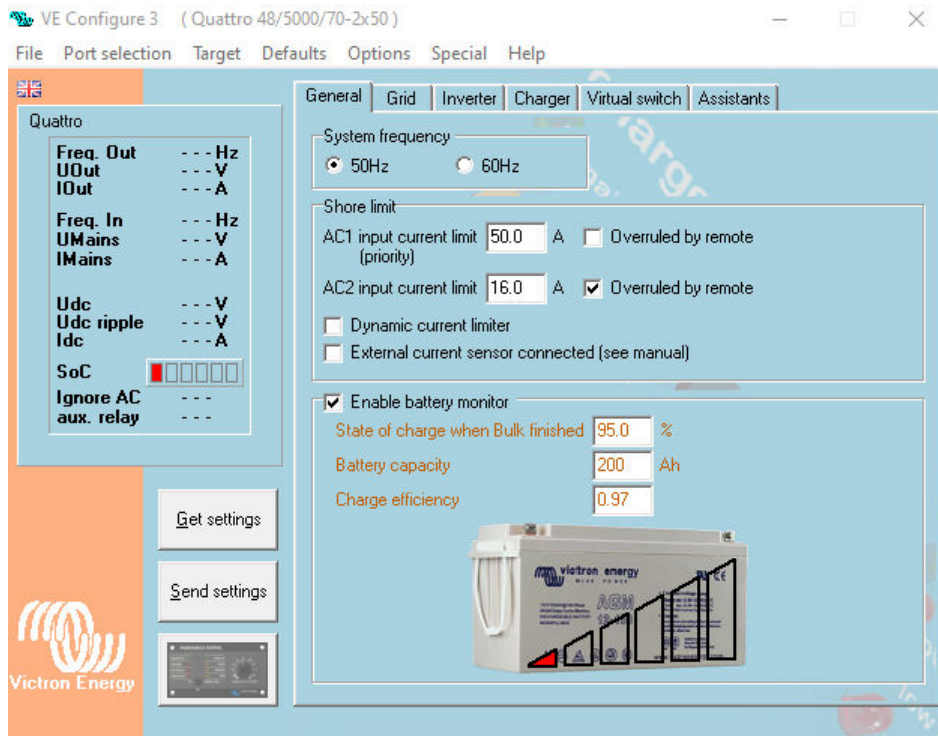
 Battery voltage	48V ▼
Max charge current	100A
Charger enabled	<input checked="" type="checkbox"/>
Battery preset	User defined ▼
Expert mode	<input type="checkbox"/>
Charge voltages	
Absorption voltage	54.60V
Float voltage	54.50V
Equalization voltage	54.00V


Figure 3: MPPT setup example

4 Inverter settings (Victron)


4.1 General Tab




4.2 Grid Tab

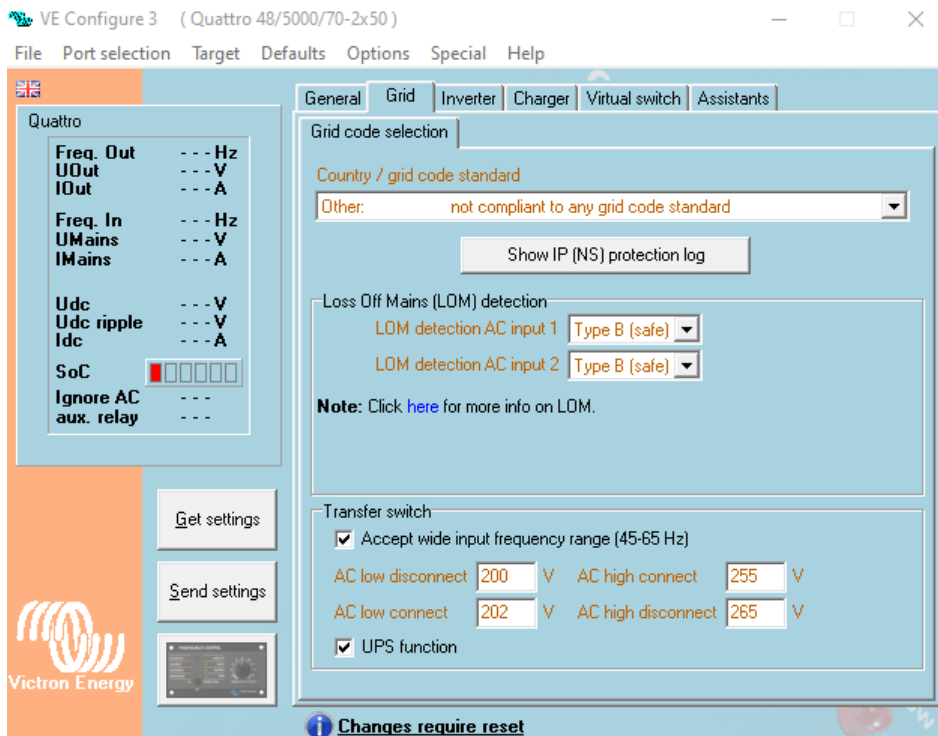

4.3 Inverter Tab

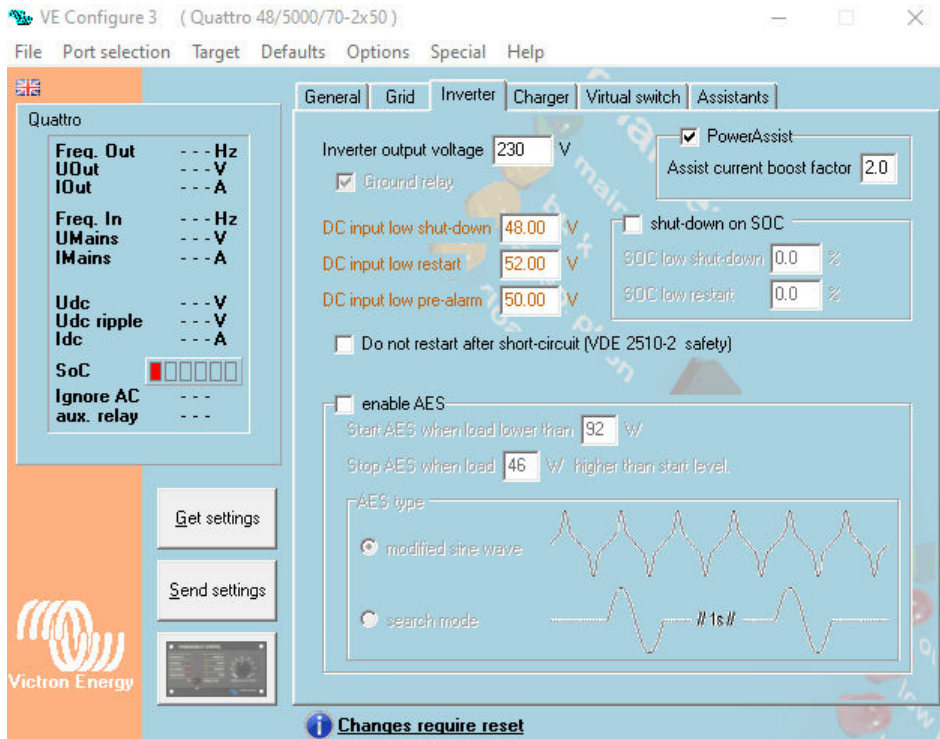


4.4 Charger Tab

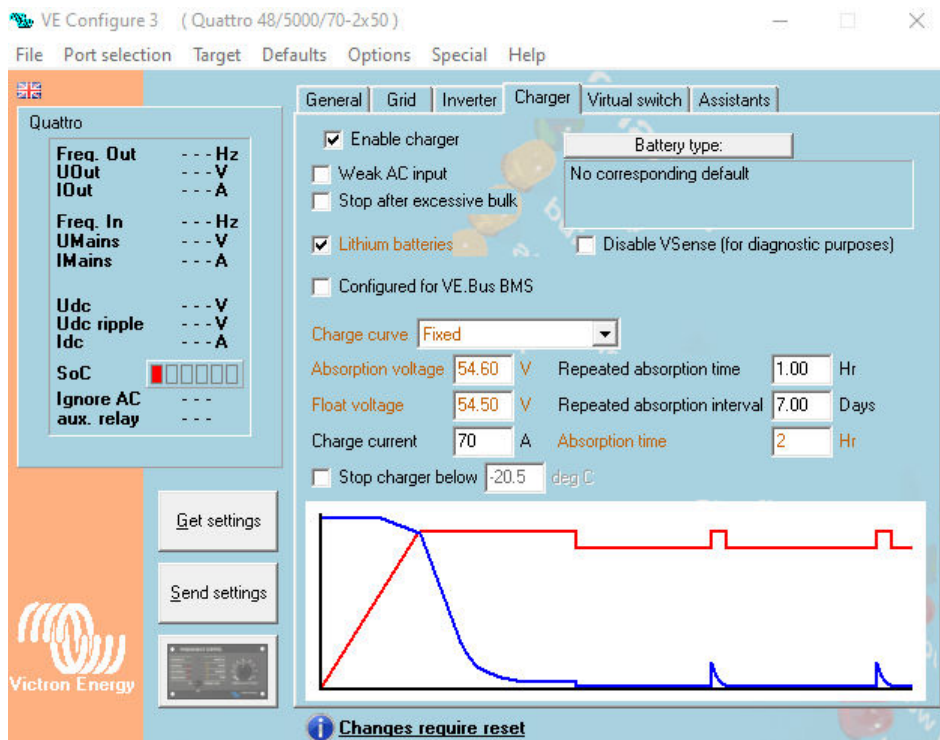


4.5 Virtual switch Tab




4.6 Assistant tab (a)

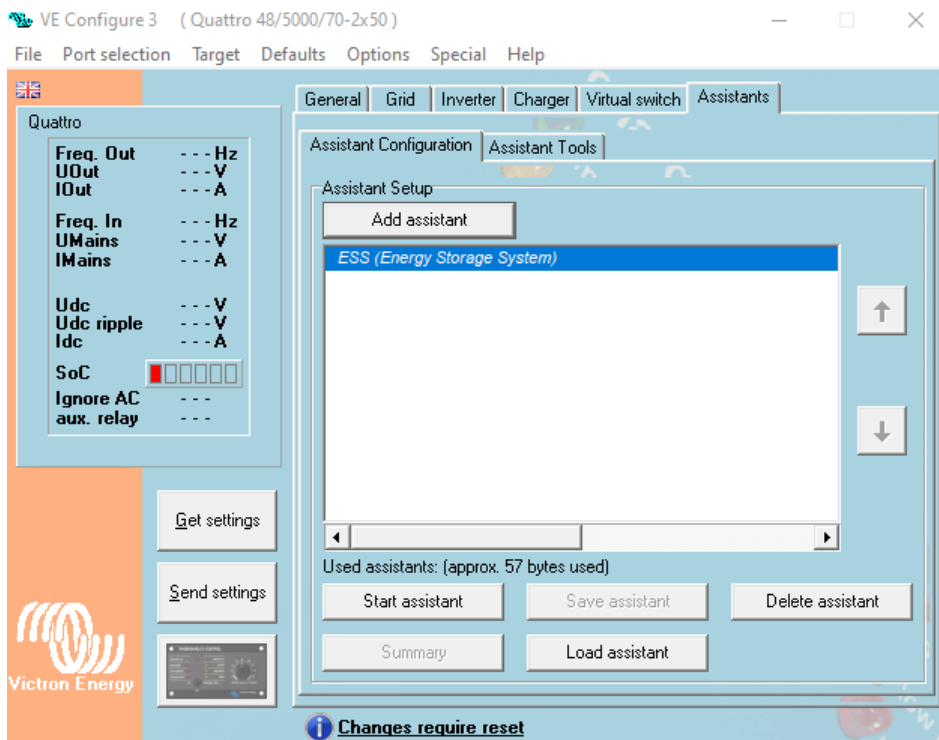


4.7 Assistant tab (b)

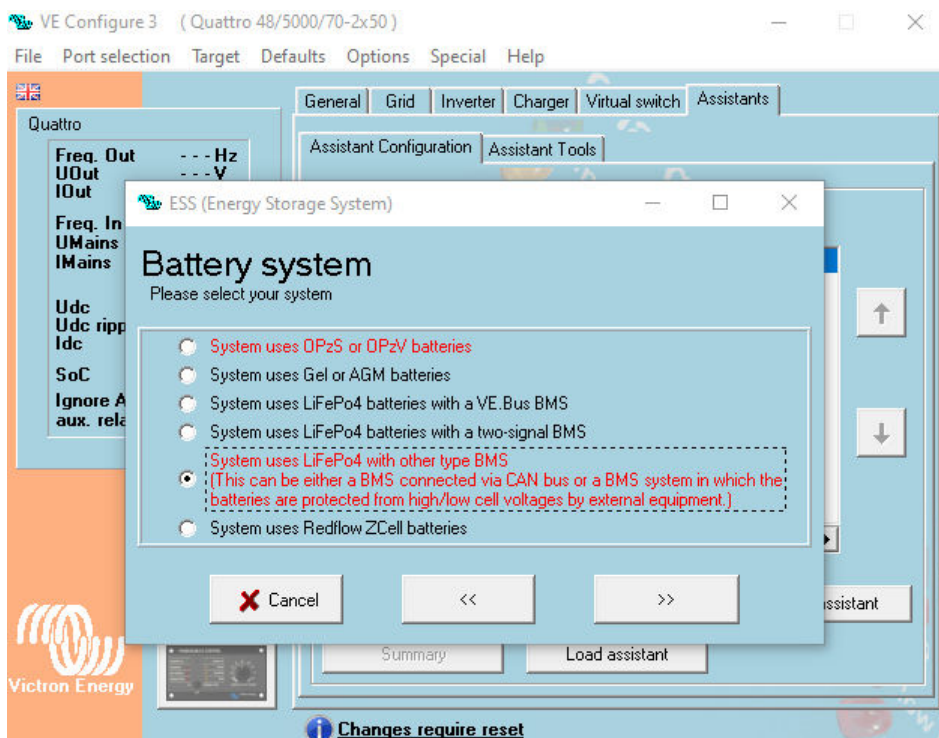


4.8 Assistant tab (c)

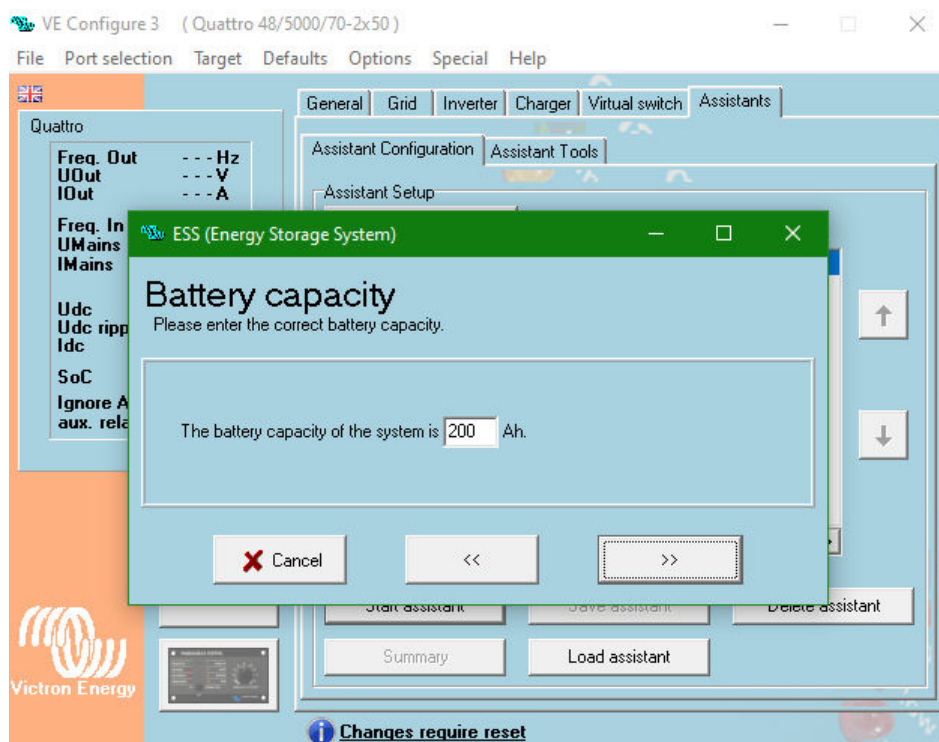


4.9 Assistant tab (d)

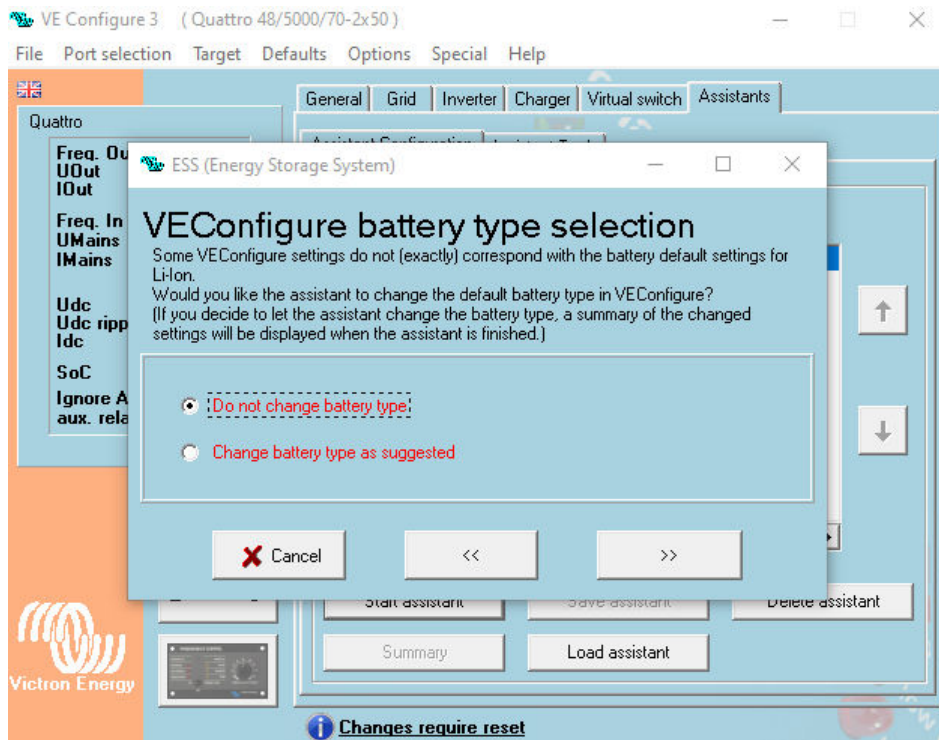


4.10 Assistant tab (e)

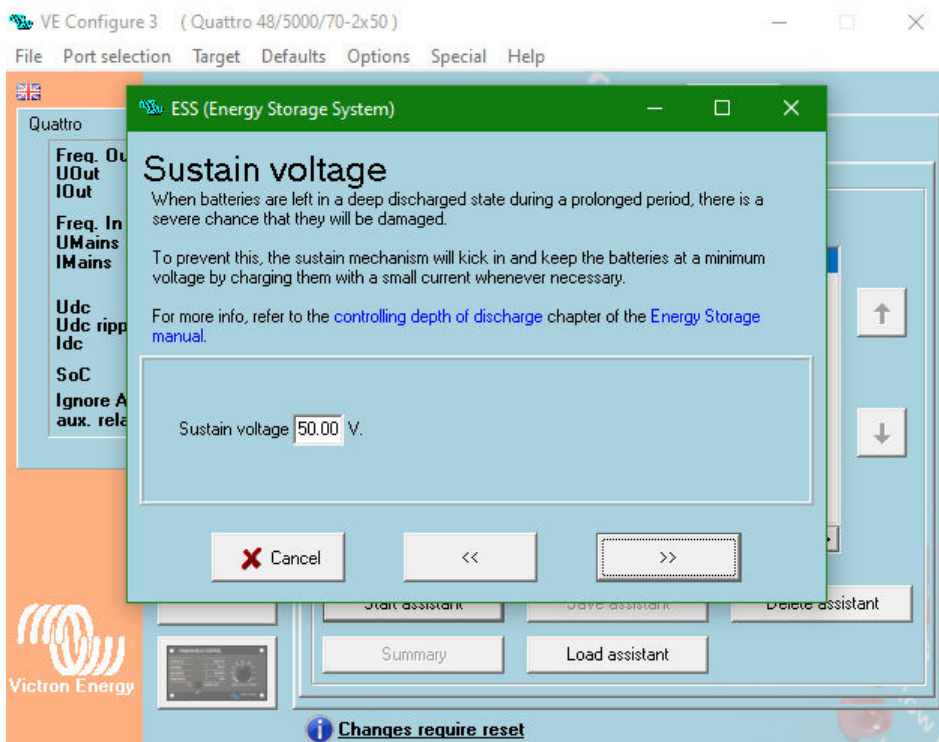

4.11 Assistant tab (f)

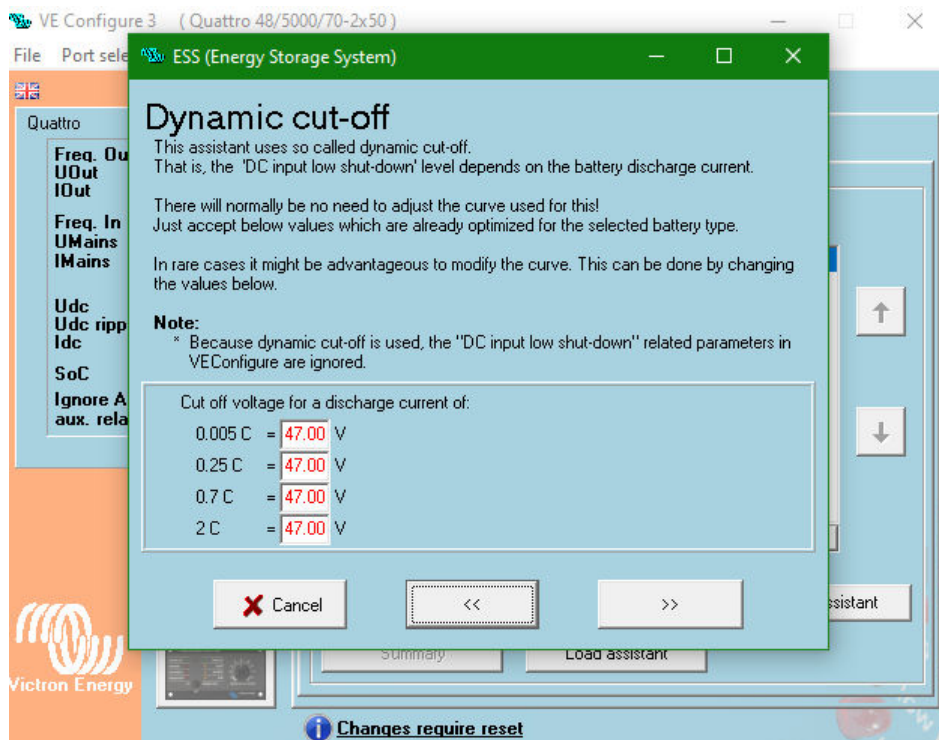

4.12 Assistant tab (g)

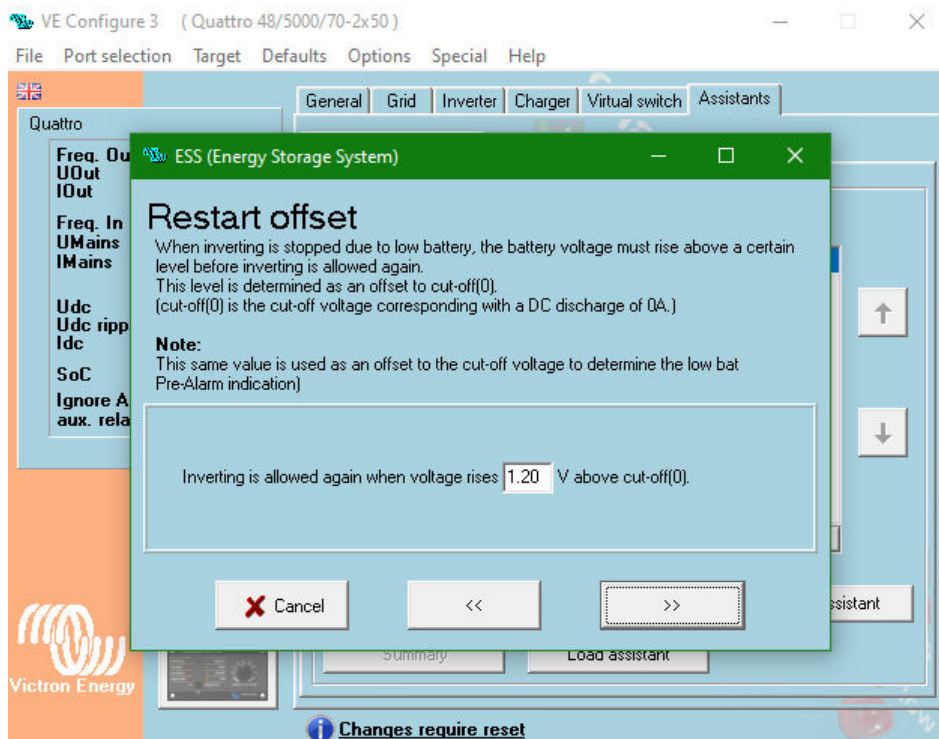

5 Revision history

Version	Date	Editor	Changes
1	Nov 2021	D. E. Cornew	-
1.1	Nov 2022	D. E. Cornew	Updated Victron configuration settings. - MMPT tab added.

Table 1: Version changes